


DISCLAIMER: THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

EAST 34TH STREET

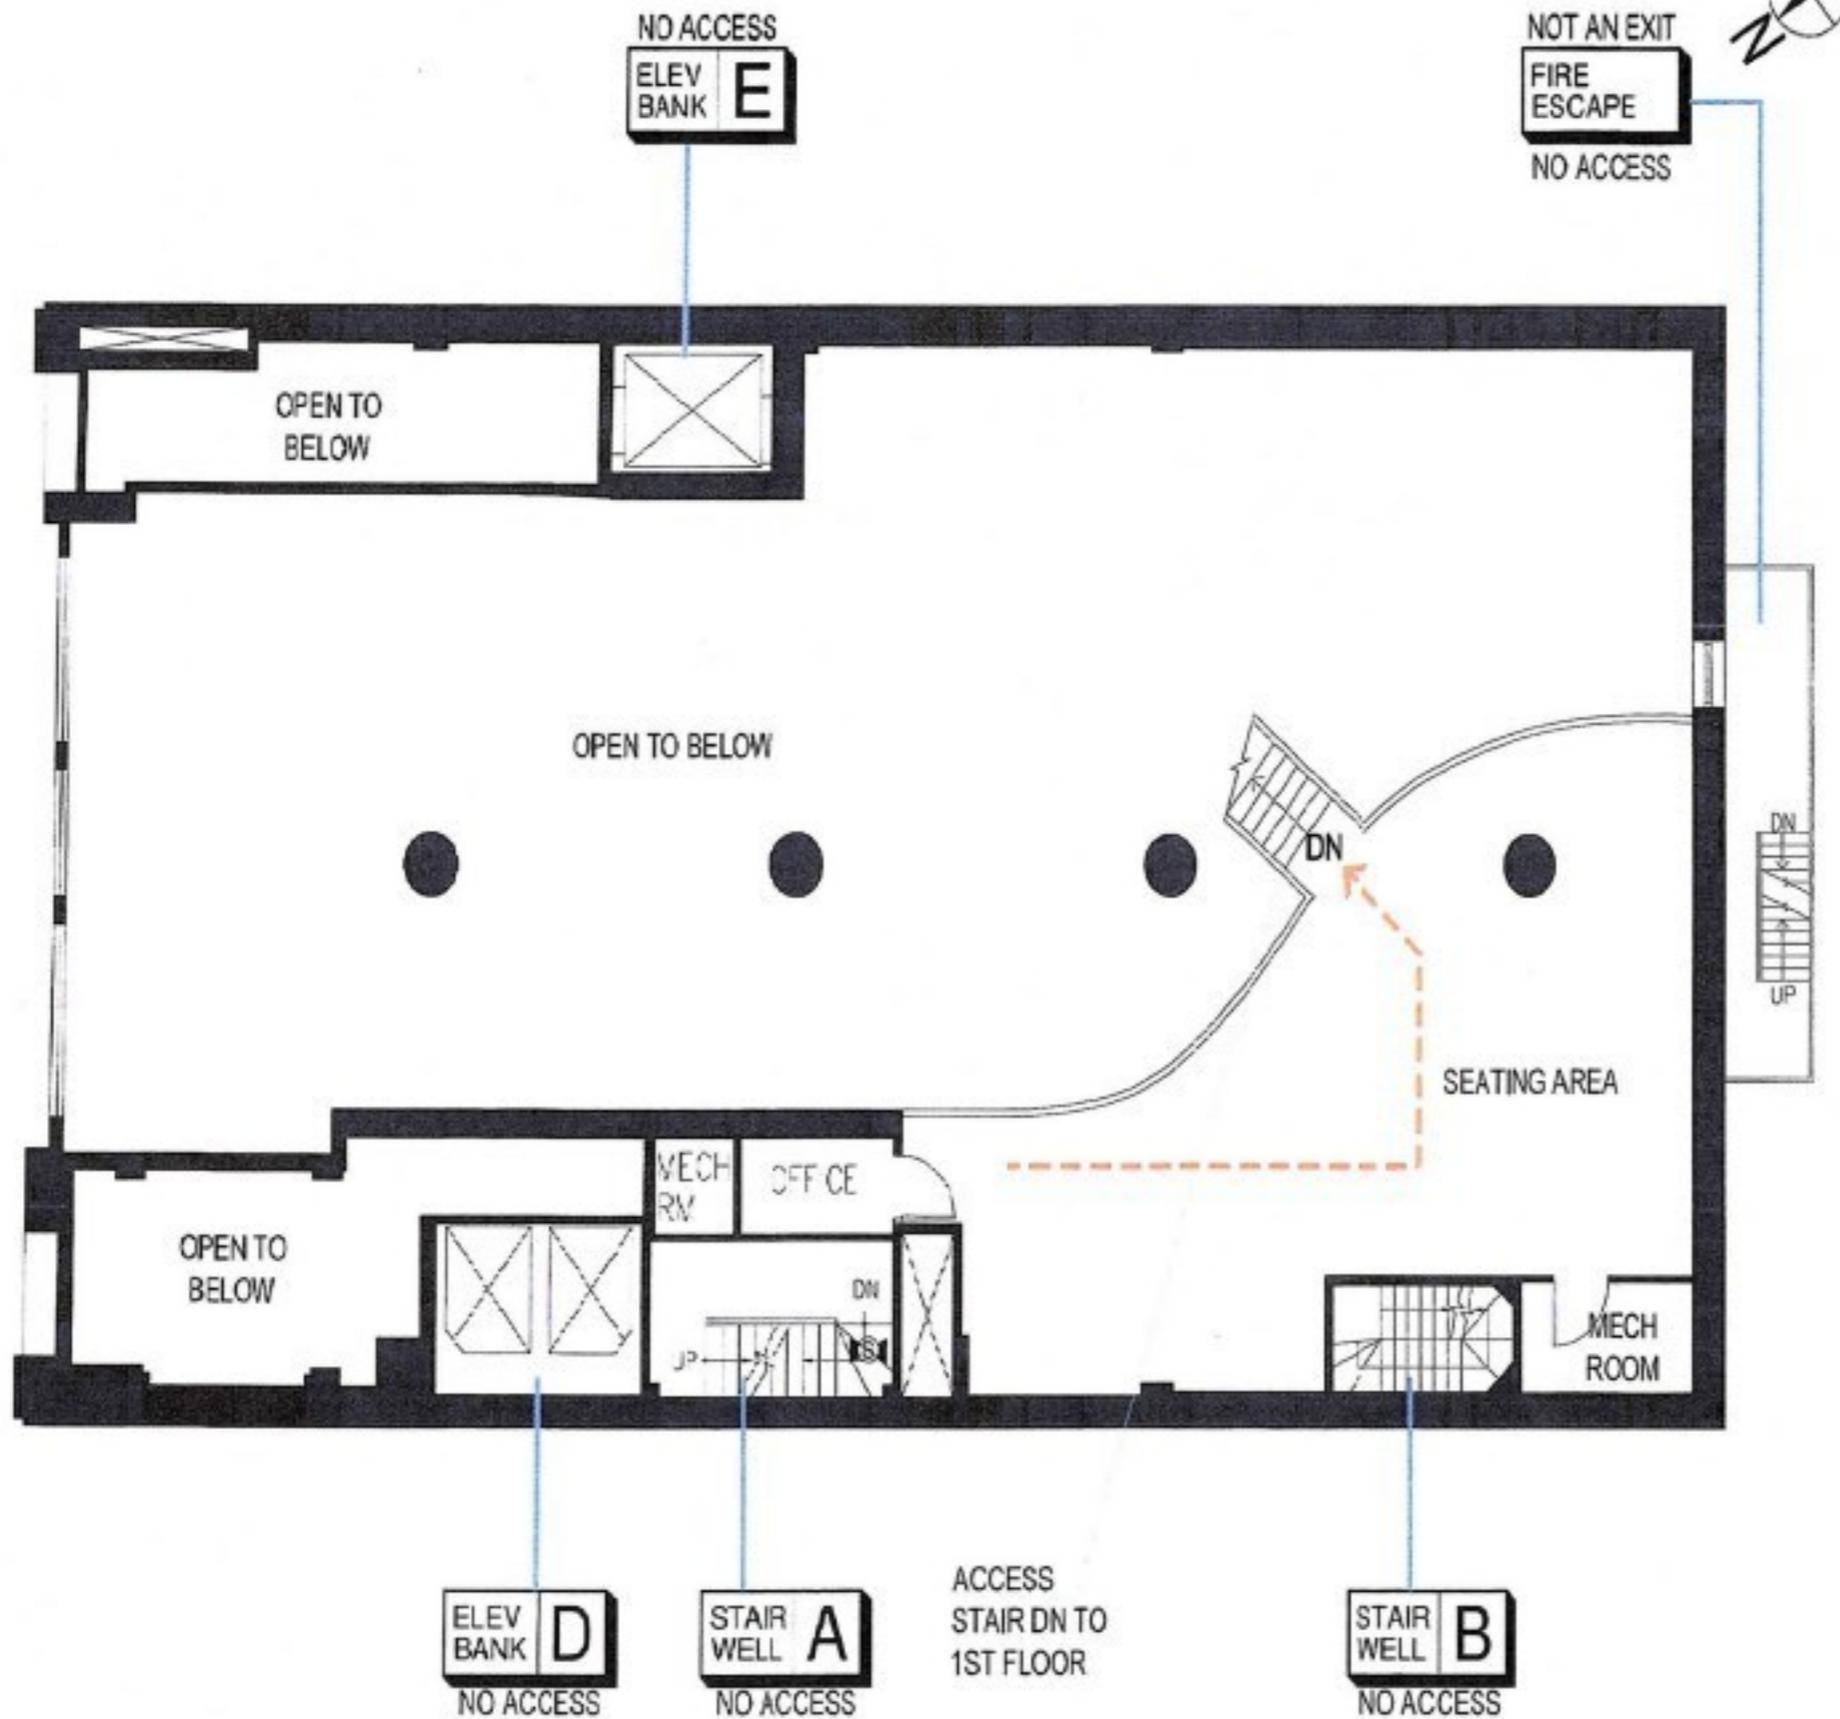

LEGEND

- MANUAL PULL STATION
- STANDPIPE HOSE OUTLET
- FIRE WARDEN STATION
- FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- COMBINATION SPRINKLER/STANDPIPE CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	REV.	ISSUES/COMMENTS
1	10/14/22	VS	ISSUES FOR HIS CONSULTING REVIEW

DRAWN BY/DATE: JG / 03.19.21 CHECKED BY/DATE: xx/xx

BUILDING ADDRESS:
10 EAST 34TH STREET
 NEW YORK, NY 10016

DRAWING TITLE:
FL-1B
MEZZANINE

SURVEY BY: SURVEY DATE(S):
 VM 10.14.22

FULL SPRINKLER COVERAGE

DISCLAIMER: THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

LEGEND

- MANUAL PULL STATION
- STANDPIPE HOSE OUTLET
- FIRE WARDEN STATION
- FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- COMBINATION SPRINKLER/STANDPIPE CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)


NO	DATE	USER	REVISED COMMENTS
1	10/24/22	VM	REVISED FOR PERMITS CONSULTING

DRAWN BY/DATE: JG / 03.19.21 CHECKED BY/DATE: XX/XX

BUILDING ADDRESS:
10 EAST 34TH STREET
 NEW YORK, NY 10016

DRAWING TITLE:
A-7
 CELLAR


SURVEY BY: VM SURVEY DATE(S): 10.14.22

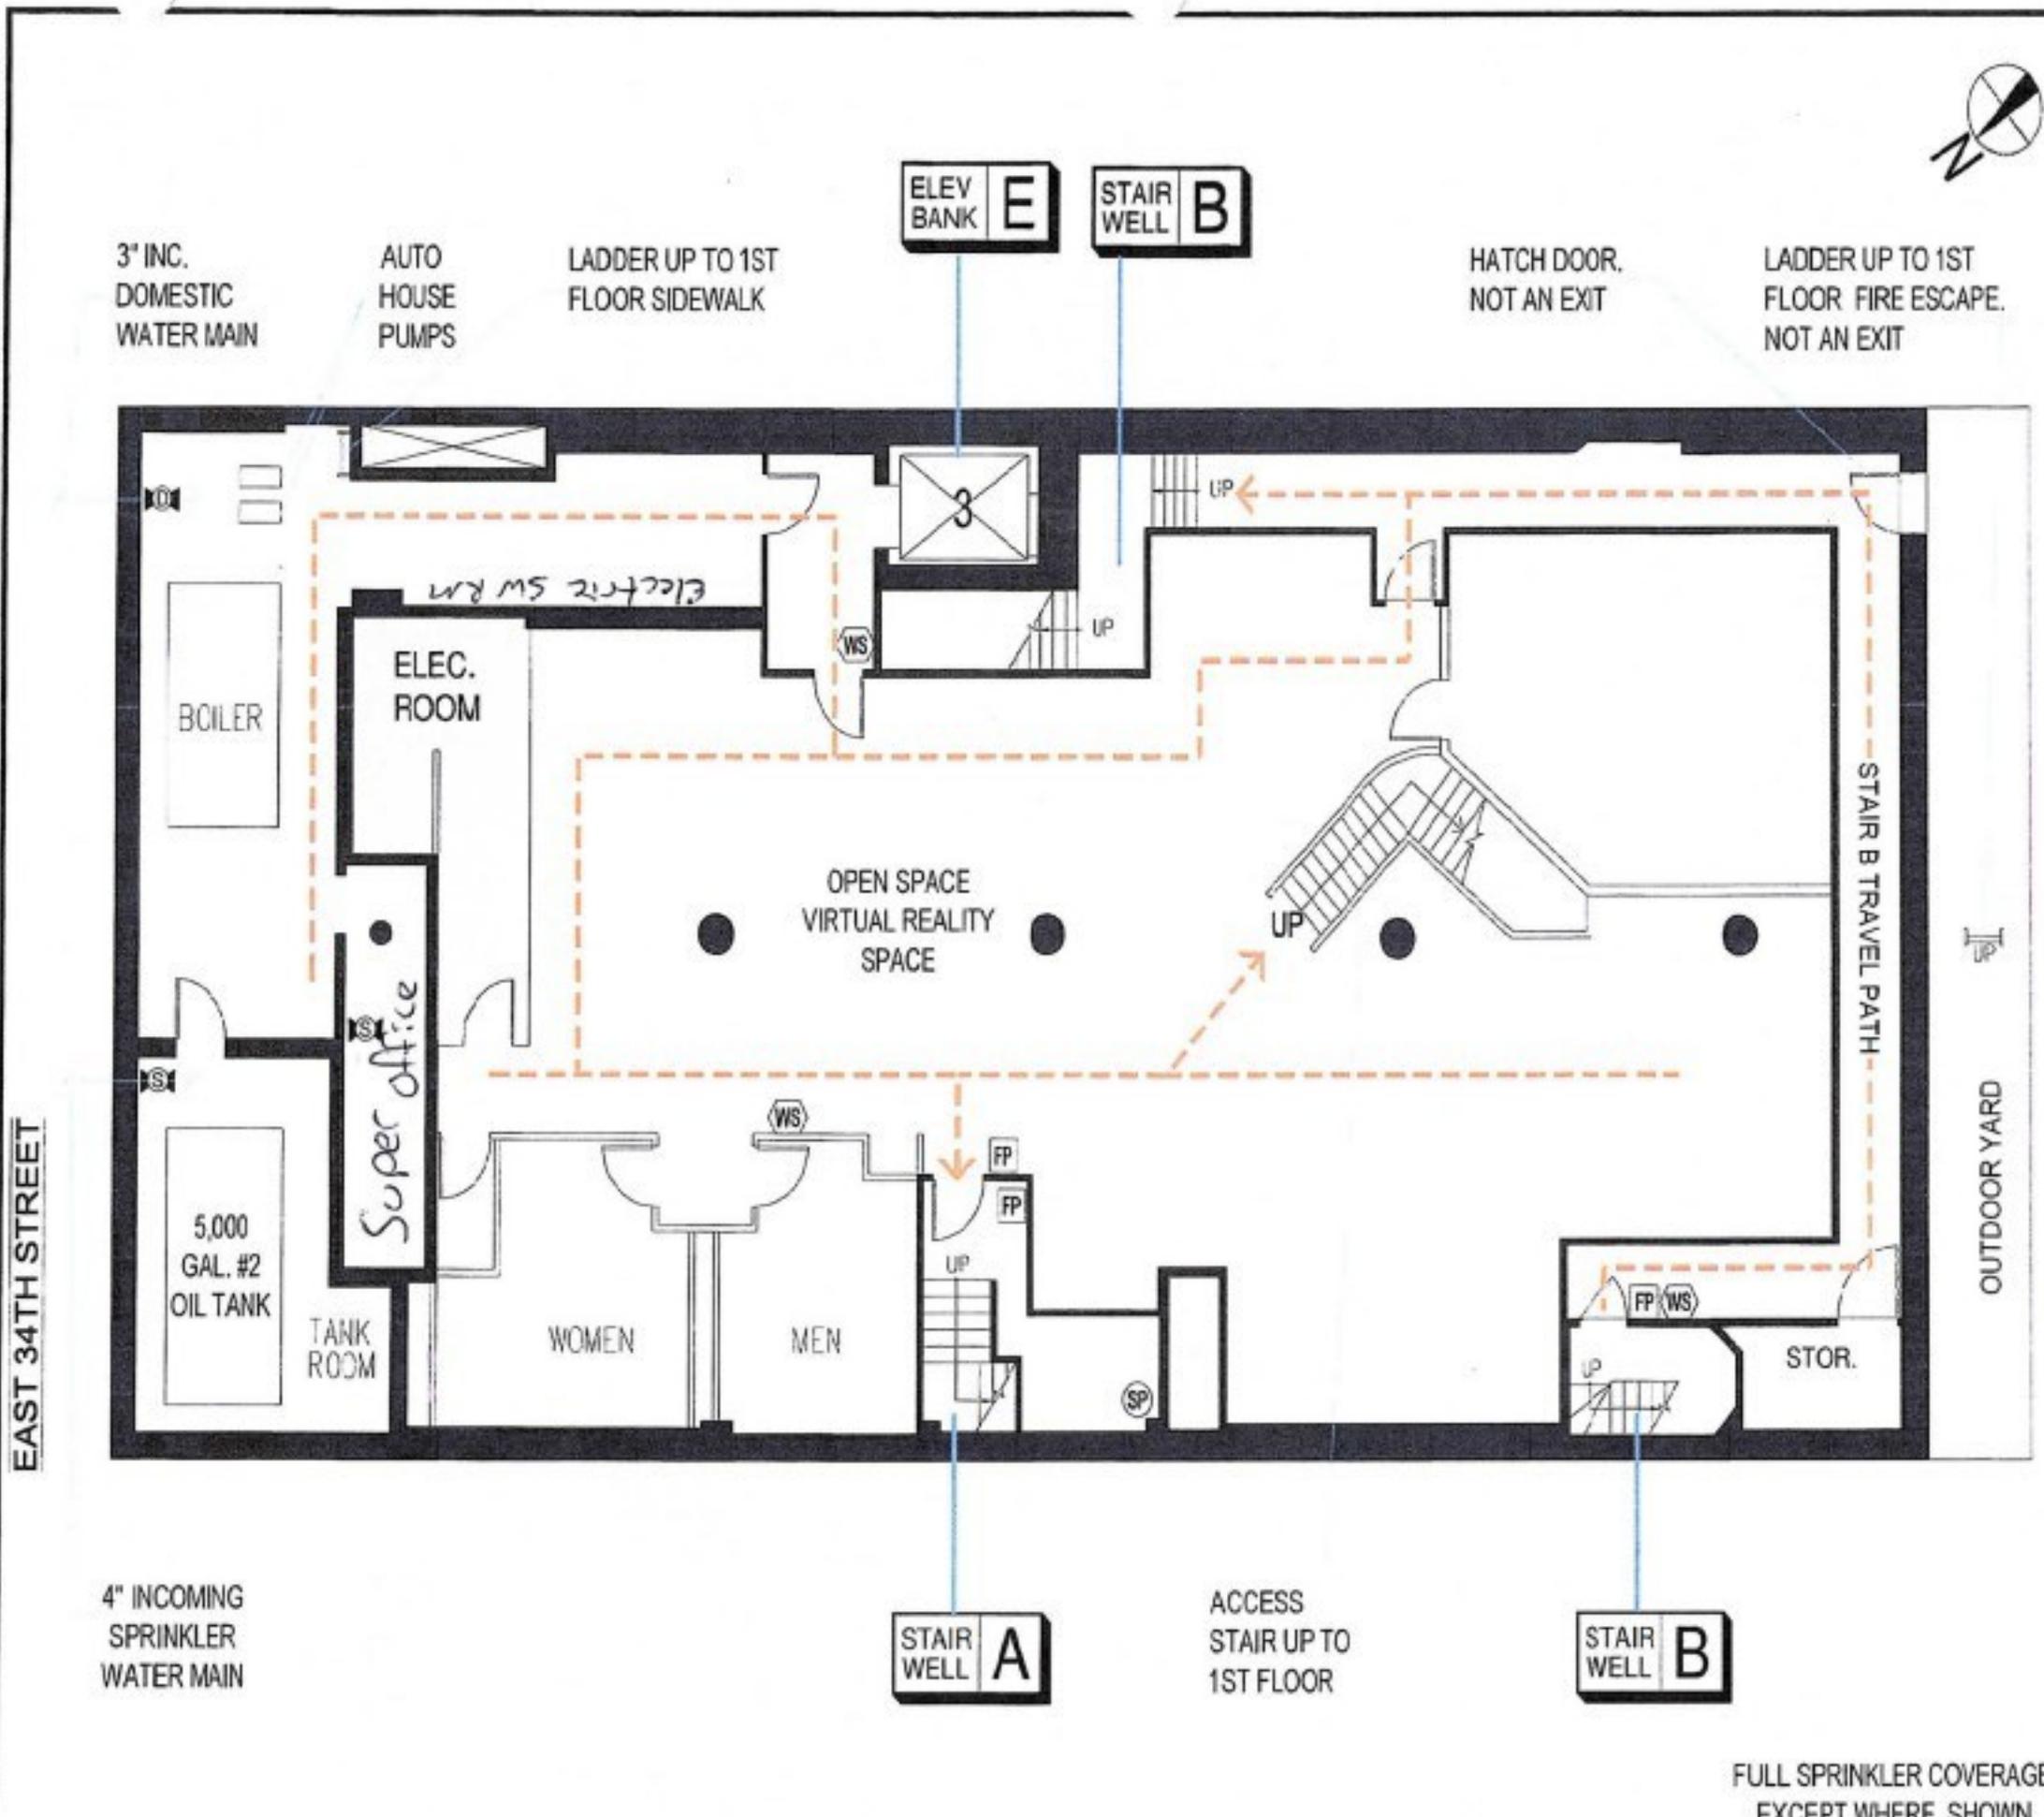

FULL SPRINKLER COVERAGE EXCEPT WHERE SHOWN

DISCLAIMER: THESE DRAWINGS WERE CREATED FOR EAP AND/OR FIRE SAFETY FILING ONLY. DRAWINGS ARE NOT TO SCALE & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

EAST 34TH STREET

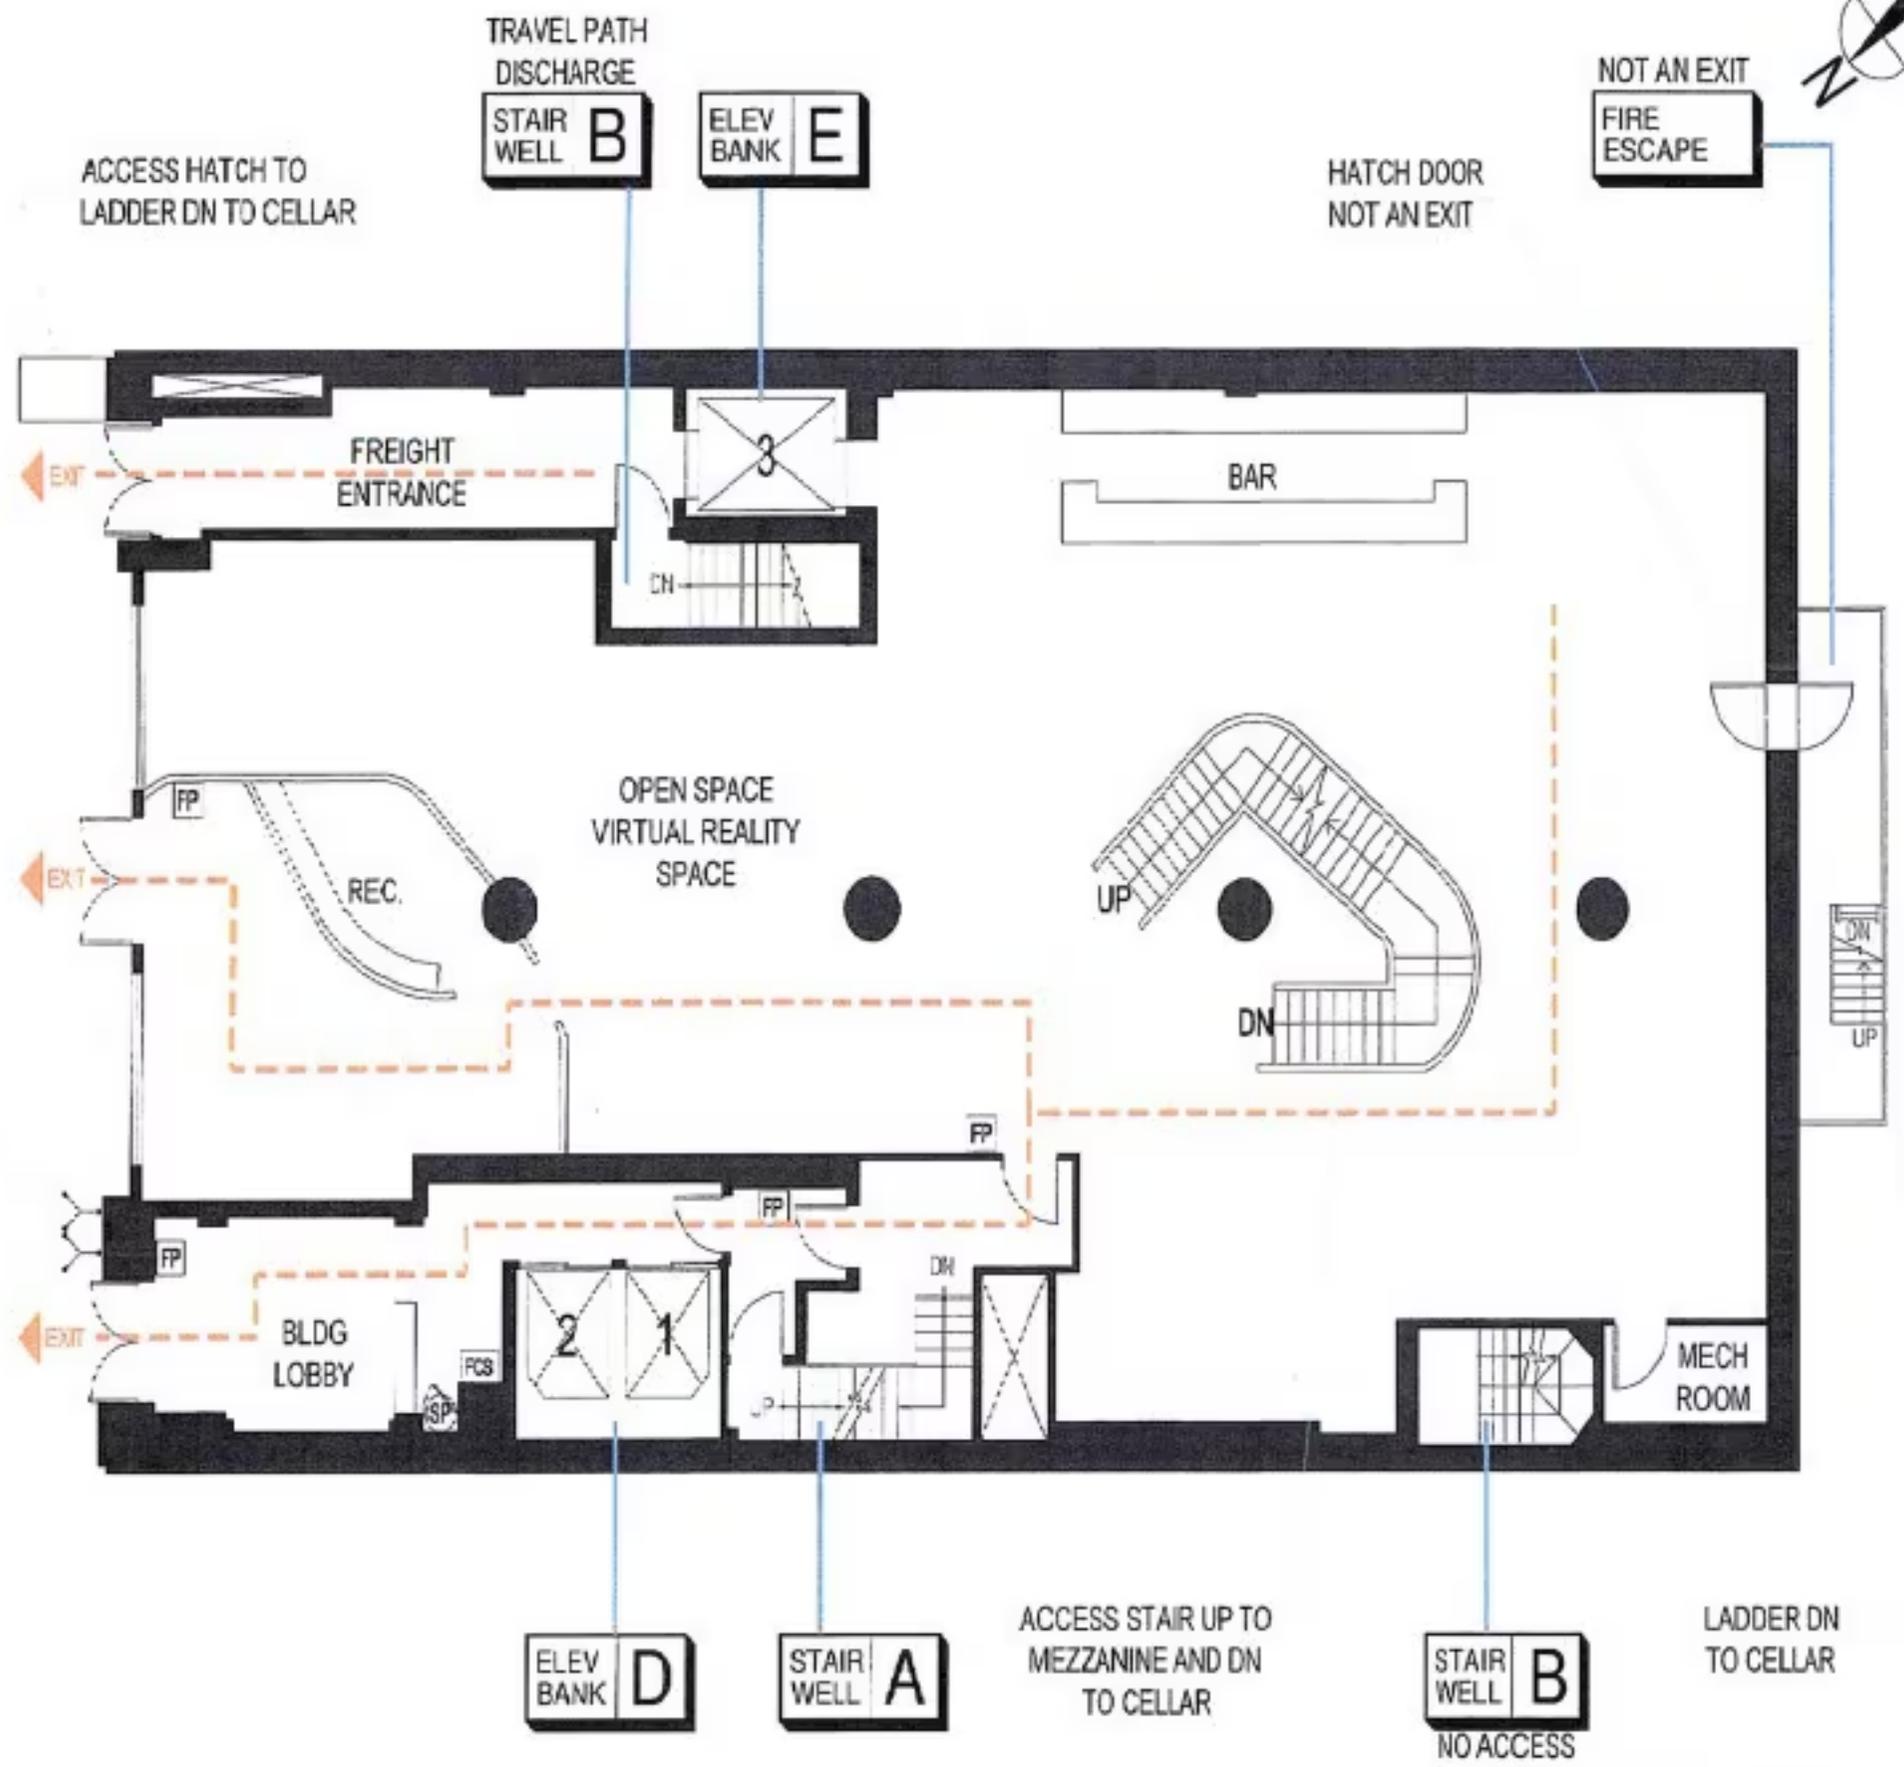

LEGEND

- MANUAL PULL STATION
- STANDPIPE HOSE OUTLET
- FIRE WARDEN STATION
- FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- COMBINATION SPRINKLER/STANDPIPE CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

ID	DATE	NAME	ISSUED COMMENTS
1	10/24/22	WS	REVISED PER FIRE DEPT. W/77 ISSUED FOR REVIEW

DRAWN BY/DATE: JG / 03.19.21 CHECKED BY/DATE: XX/XX

BUILDING ADDRESS:
10 EAST 34TH STREET
 NEW YORK, NY 10016

DRAWING TITLE:
FL-1
1ST FLOOR

SURVEY BY: WS SURVEY DATE(S): 10.14.22

FIRE DEPT. COMBINATION CONNECTION
 FIRE DEPT. SPRINKLER CONNECTION

TRAVEL PATH DISCHARGE
 STAIR WELL B ELEV BANK E

NOT AN EXIT
 FIRE ESCAPE

ELEV BANK D STAIR WELL A

STAIR WELL B
 NO ACCESS

ACCESS STAIR UP TO MEZZANINE AND DN TO CELLAR

FULL SPRINKLER COVERAGE
 SPRINKLER VALVE LOCATED ON MEZZANINE