Suite 1201

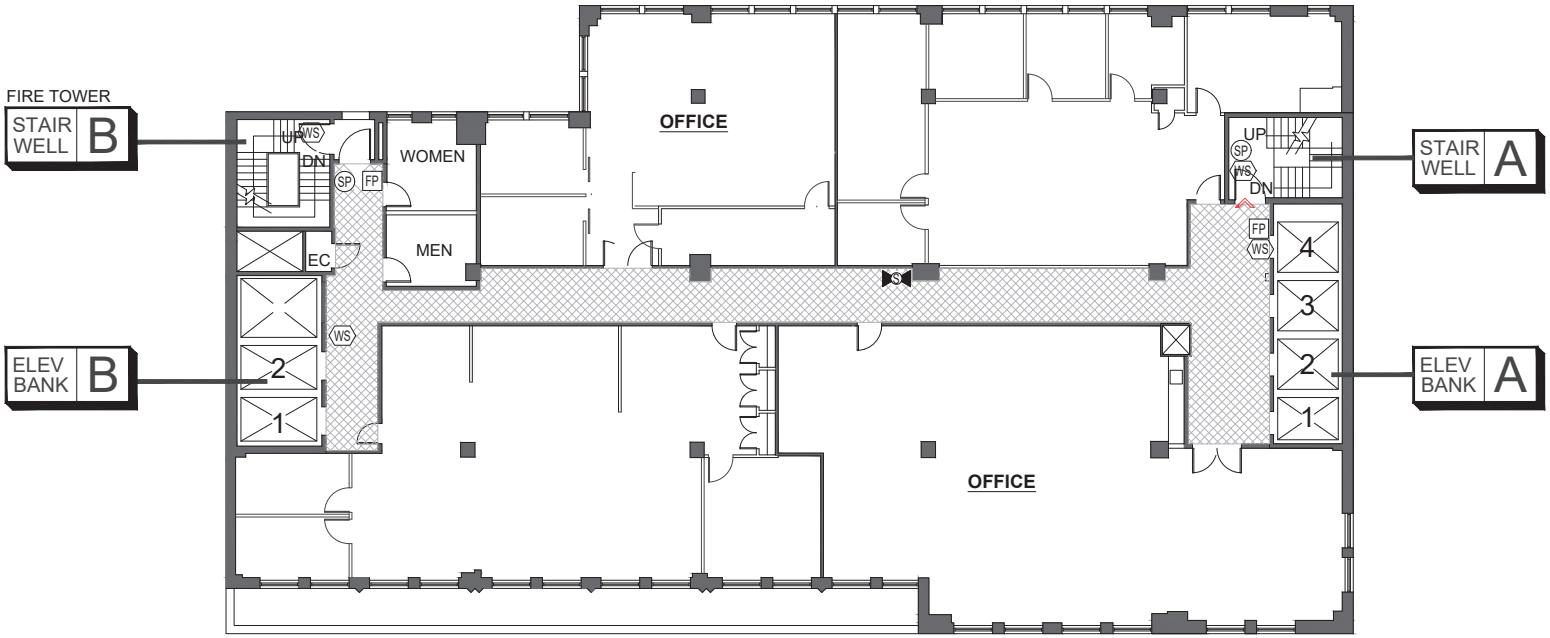

WEST 30TH STREET

NOTE: FULL SPRINKLER COVERAGE

LEGEND

- FP MANUAL PULL STATION
- SP STANDPIPE HOSE OUTLET
- WS FIRE WARDEN STATION
- FCS FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SP STANDPIPE CONTROL VALVE
- S SPRINKLER CONTROL VALVE
- D DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	10.01.20	MB	REVISED PER SURVEY 09.15.20 ISSUED FOR REVIEW AND FILING
2	10.08.20	JW	REVISED PER COMMENTS ISSUED FOR REVIEW.

DRAWN BY/DATE: KM

CHECKED BY/DATE: DL

BUILDING ADDRESS:
150 WEST 30TH ST
NEW YORK, NY 10001

DRAWING TITLE:
FL-12
12TH FLOOR

SURVEY BY: AR

SURVEY DATE(S): 09.15.20