



LEGEND

- FP MANUAL PULL STATION
- SP STANDPIPE HOSE OUTLET
- WS FIRE WARDEN STATION
- FCS FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SP STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- ← EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOOR WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	07.15.15	CW	ISSUED FOR REVIEW
2	08.03.15	AT	ISSUED FOR REVIEW
3	06.17.19	RK	ISSUED FOR REVIEW
4	11.14.22	JG	UPDATED PER LATEST SURVEY ISSUED FOR REVIEW AND FILING


DRAWN BY/DATE: JG/AT CHECKED BY/DATE: XXX

BUILDING ADDRESS:
36 West 25th Street
 New York, N.Y. 10010

DRAWING TITLE:
FL-8
 8th Floor

SURVEY BY:
 JG

WEST 25TH STREET

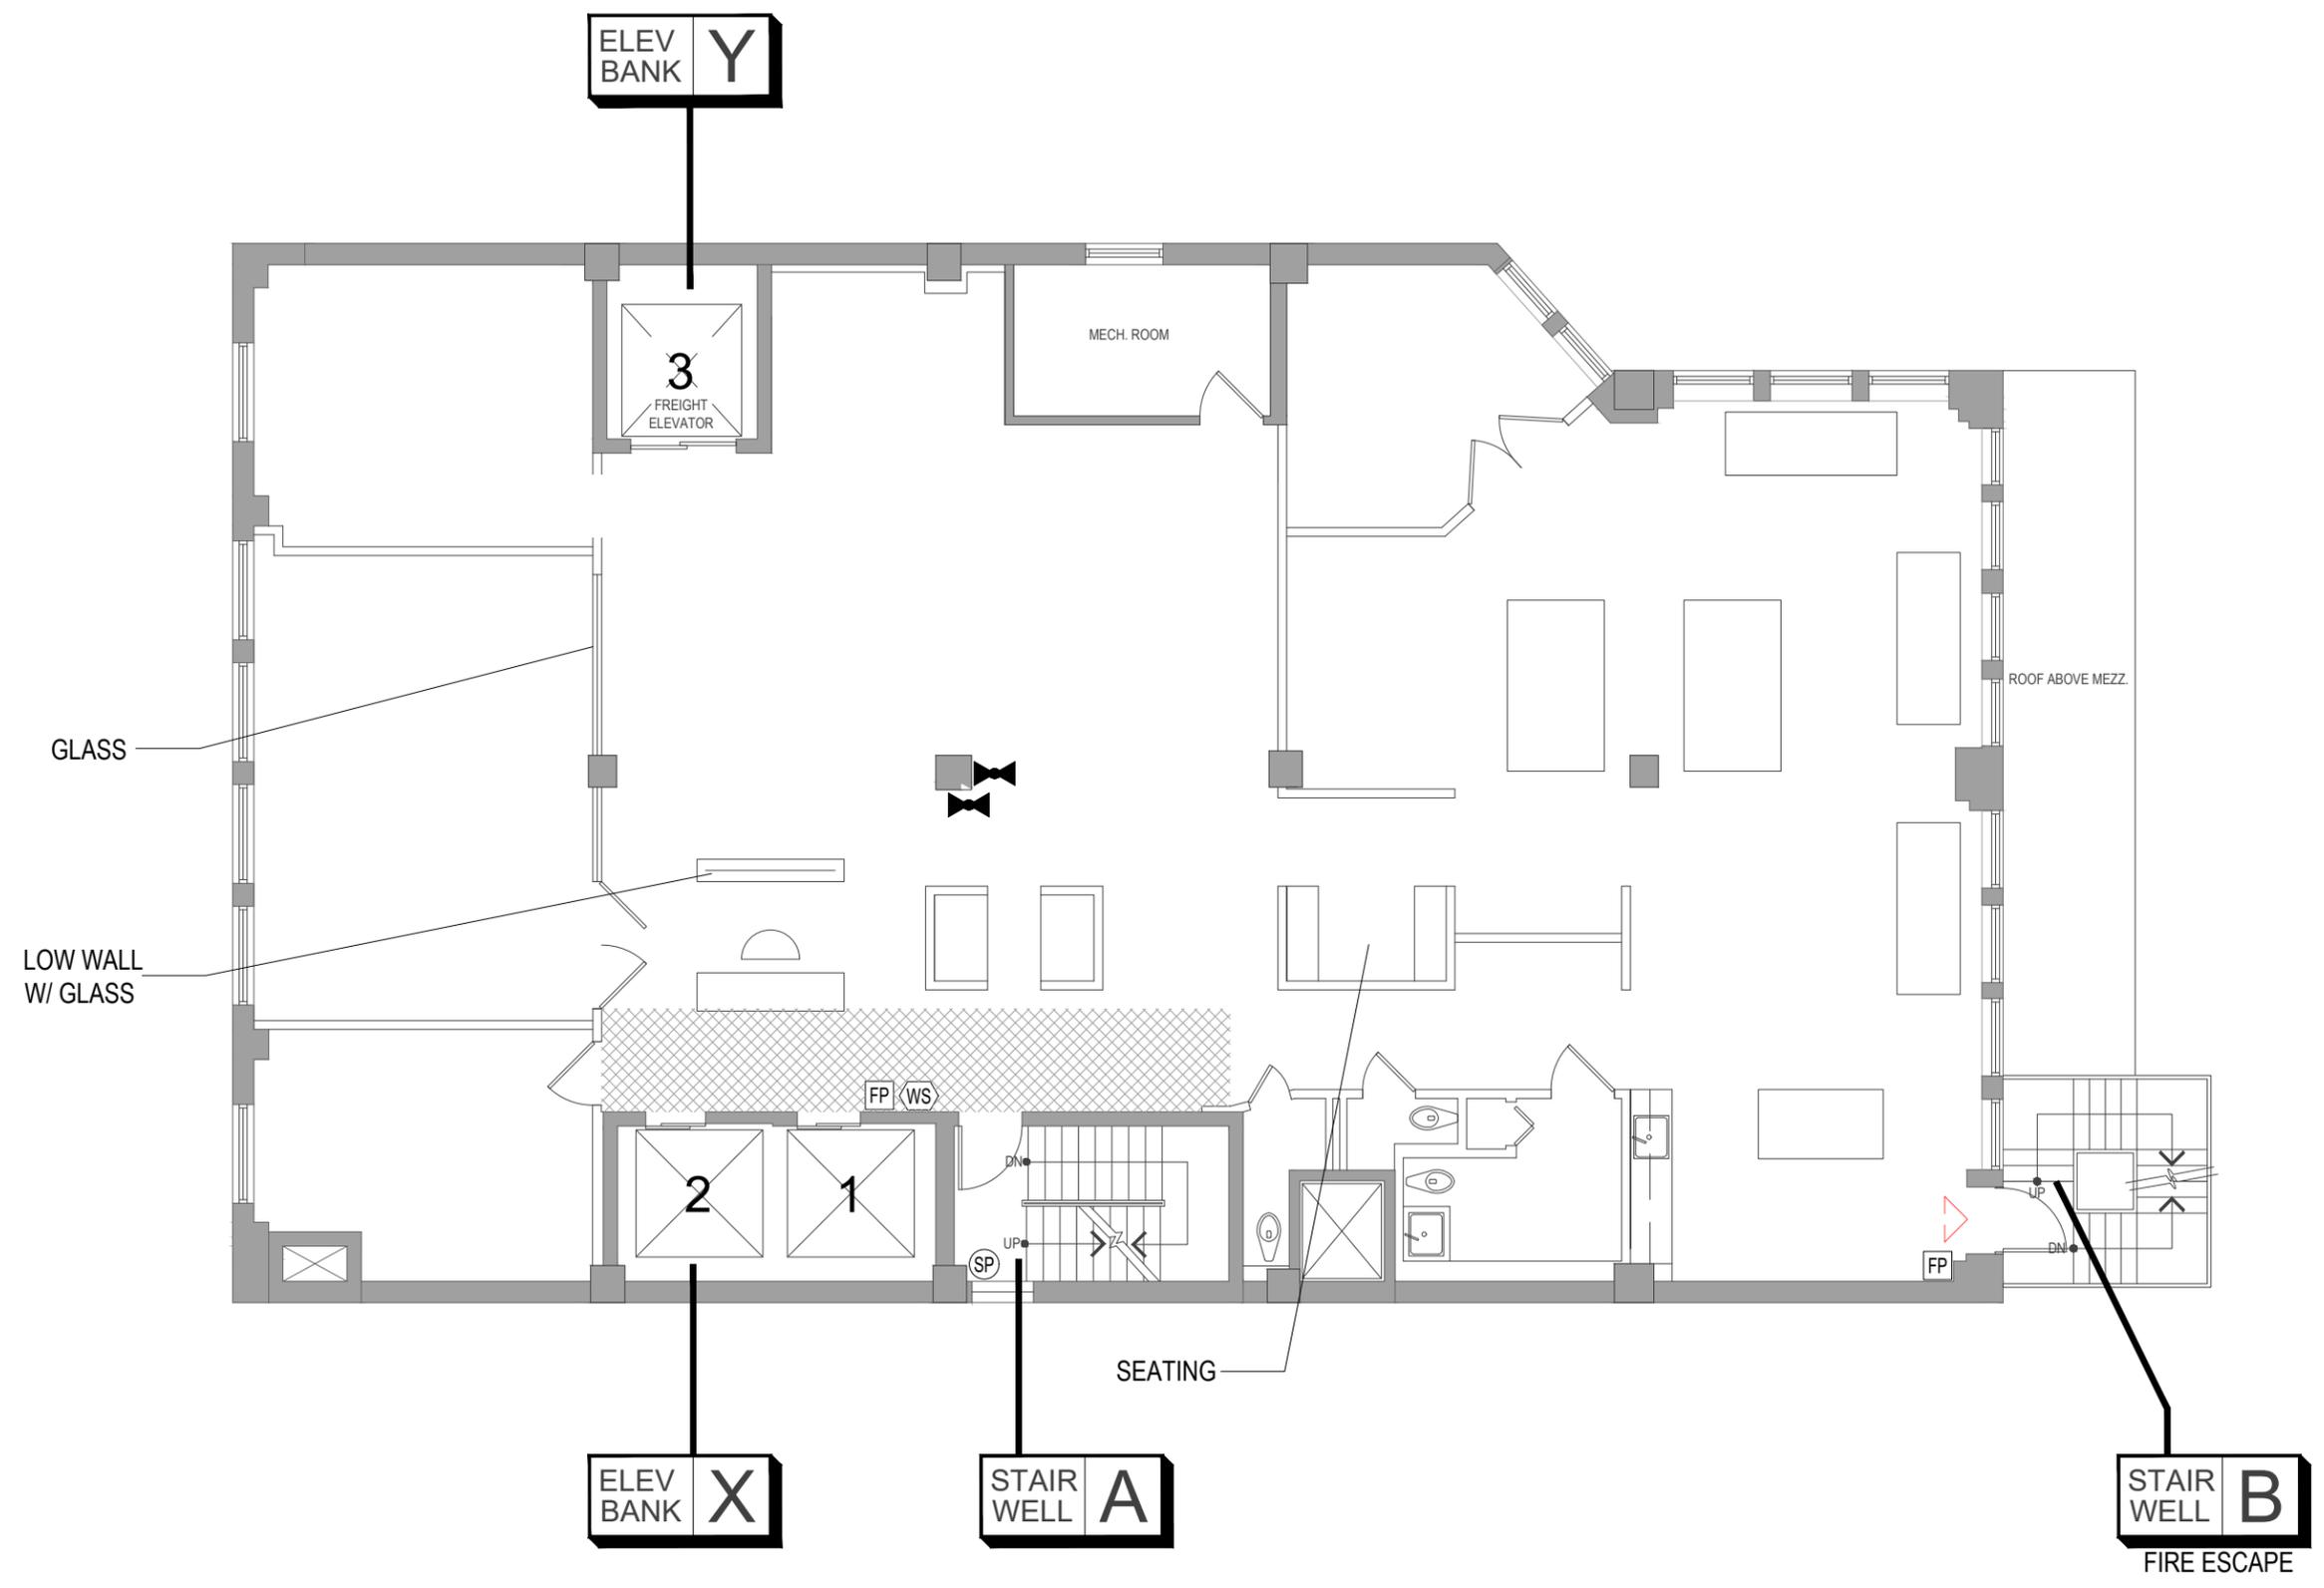

FULL SPRINKLER COVERAGE

