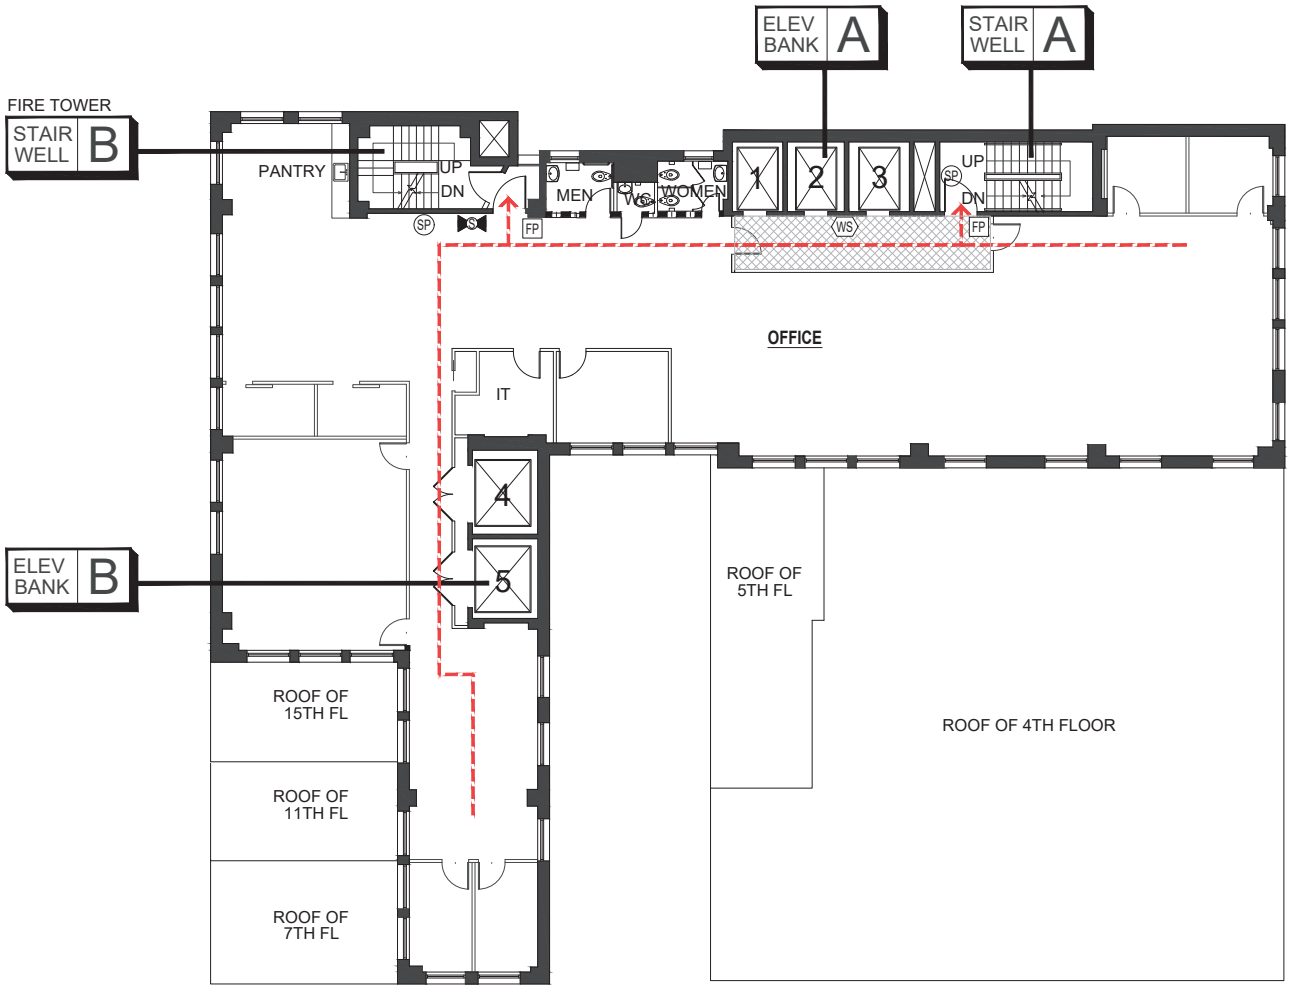


N

NOTE: FULL SPRINKLER COVERAGE

LEGEND

- FP — MANUAL PULL STATION
- SP — STANDPIPE HOSE OUTLET
- WS — FIRE WARDEN STATION
- FCS — FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SPCV — STANDPIPE CONTROL VALVE
- SCV — SPRINKLER CONTROL VALVE
- DCV — DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- 1-HR FIRE BARRIER
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	11.04.21	JW	REVISED PER SURVEY 10.08.21 ISSUED FOR REVIEW AND FILING

DRAWN BY/DATE:	CHECKED BY/DATE:
KM	DL

BUILDING ADDRESS:
350 SEVENTH AVE.
NEW YORK, NY 10001

DRAWING TITLE:
FL-18
18TH FLOOR

SURVEY BY:	SURVEY DATE(S):
KM	10.08.21